


**AIR GAP** - MINIMUM OF TWICE  
THE INLET PIPE DIAMETER  
ABOVE THE FLOOD RIM BUT  
NEVER LESS THAN 1 INCH.

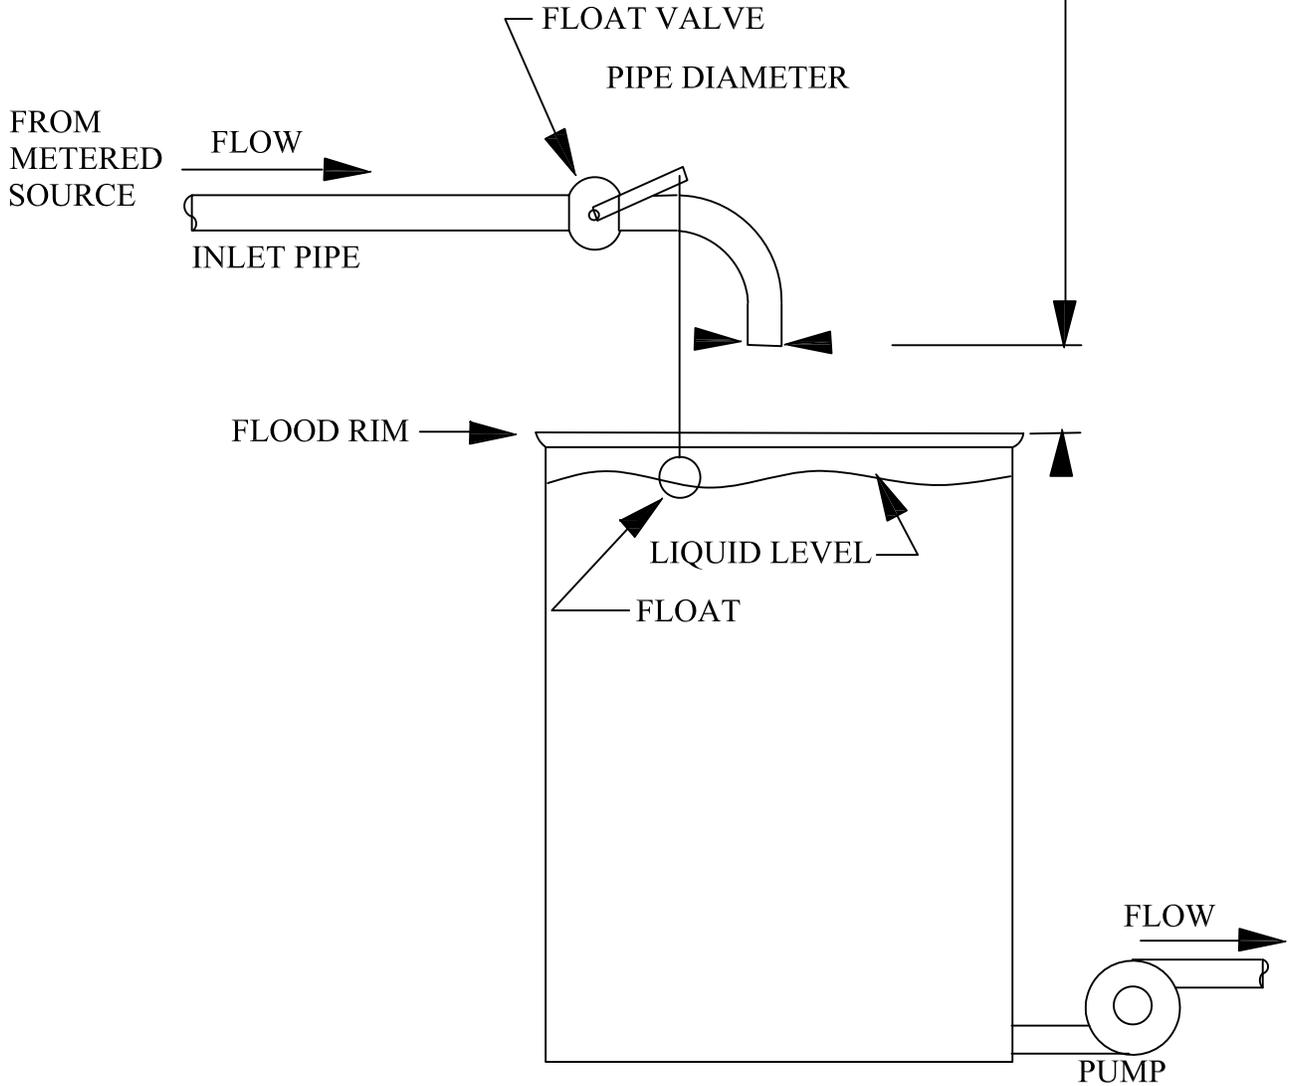

REVISION	APPROVED	DATE	CITY OF COEUR d'ALENE STANDARD DRAWING	APPROVED BY:
			<b>APPROVED AIR GAP</b>	<i>Andon Robles</i> 4/20/15
				CITY ENGINEER, PE 7432 DATE:
				DWG NO. W-27