



SERVICE LINE RECONNECTION TO REPLACED WATER MAIN

TOP VIEW

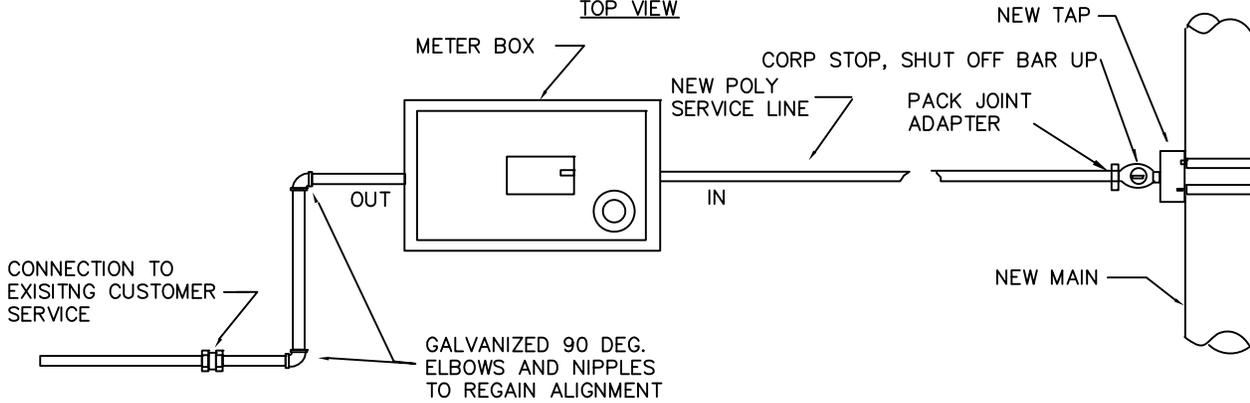

SERVICE LINE RECONNECTION TO REPLACED WATER MAIN

SIDE VIEW

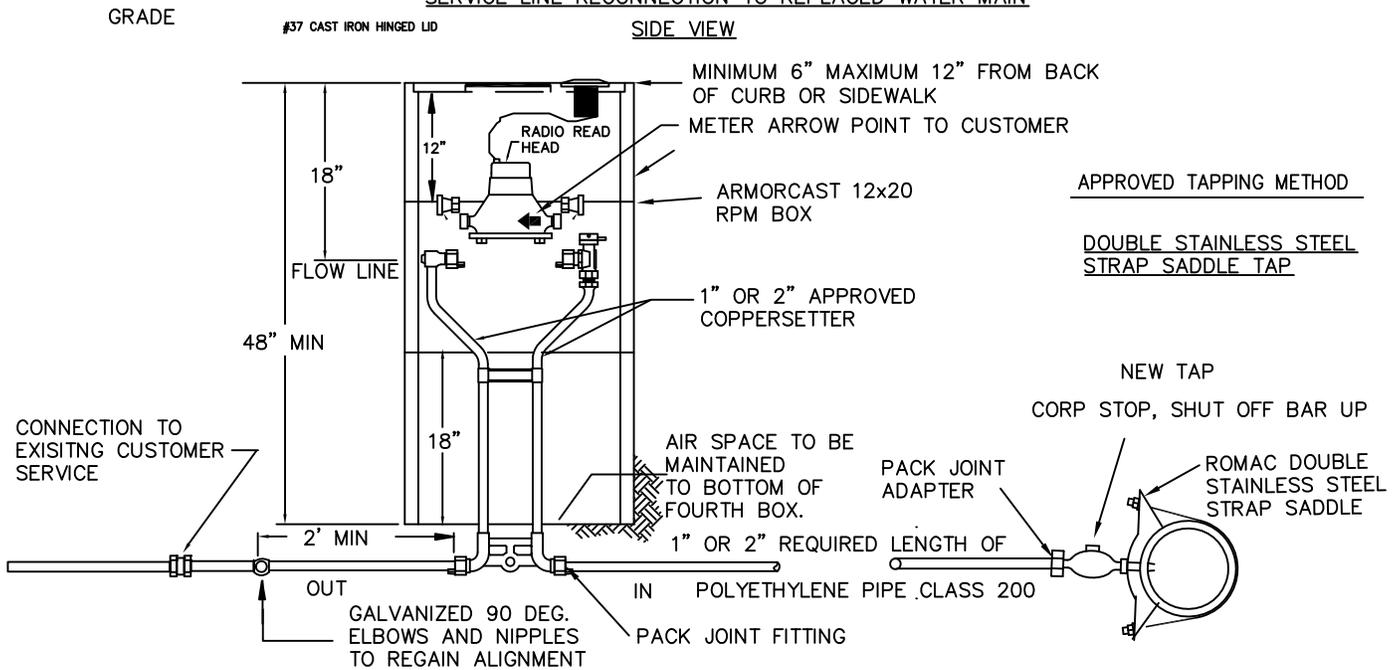

APPROVED TAPPING METHOD

DOUBLE STAINLESS STEEL STRAP SADDLE TAP

NOTES:

1. MAIN TO HAVE 4'-6" MINIMUM OF COVER TO FINISHED GRADE.
2. SERVICE TO BE PRESSURE TESTED TO METER ANGLE STOP.
3. ALL MATERIALS TO CONFORM TO NSF-61 STANDARDS FOR LEAD FREE MATERIALS WHICH MAY COME INTO CONTACT WITH POTABLE WATER SUPPLY.
4. RECONNECTION TO EXISTING SERVICE WILL BE ACCOMPLISHED USING EITHER A GALVANIZED COMPRESSION COUPLING, A BRASS PACK JOINT COUPLING FOR GALVANIZED PIPE AND/OR COPPER PIPE, OR A PACK JOINT ADAPTER FOR POLY PIPE.
5. THE SWING JOINT FROM THE COPPERSETTER TO THE EXISTING SERVICE SHALL BE GALVANIZED PIPE TO STABILIZE THE COPPERSETTER.
6. POLYETHYLENE PIPE SHALL BE USED FOR SERVICE REPLACEMENT FROM THE MAIN TO THE COPPERSETTER.
7. NO PRIVATE CONNECTIONS OR FITTINGS ARE ALLOWED IN OR UNDER THE METER BOX.
8. ALL WORK SHALL BE INSPECTED BY THE WATER DEPT. INSPECTOR BEFORE BACKFILLING CAN TAKE PLACE.

REVISION	APPROVED	DATE	CITY OF COEUR d'ALENE STANDARD DRAWING	APPROVED BY:
			<b>1" &amp; 2" SERVICE RECONNECT</b>	<i>Madon Debes</i> 4/20/15 CITY ENGINEER, PE 7432
				DWG NO. W-33