


NOTES THIS DETAIL:

1. TEMPORARY TEES ARE ONLY PERMITTED WHEN A FUTURE PUBLIC SEWER EXTENSION IS PLANNED WITHIN A PHASED DEVELOPMENT OR AS APPROVED BY THE CITY.
2. TEMPORARY TEES ON SEWER MAINS WITH LATERAL CONNECTIONS BETWEEN DOWNSTREAM MANHOLE AND TEMPORARY TEE ARE NOT ACCEPTABLE.
3. ALL PIPE AND FITTINGS SHALL BE PVC SDR 35 CONFORMING TO ASTM D3034.
4. ALL PVC JOINTS SHALL BE COMPRESSION GASKET TYPE. GLUED JOINTS ARE NOT ACCEPTABLE.

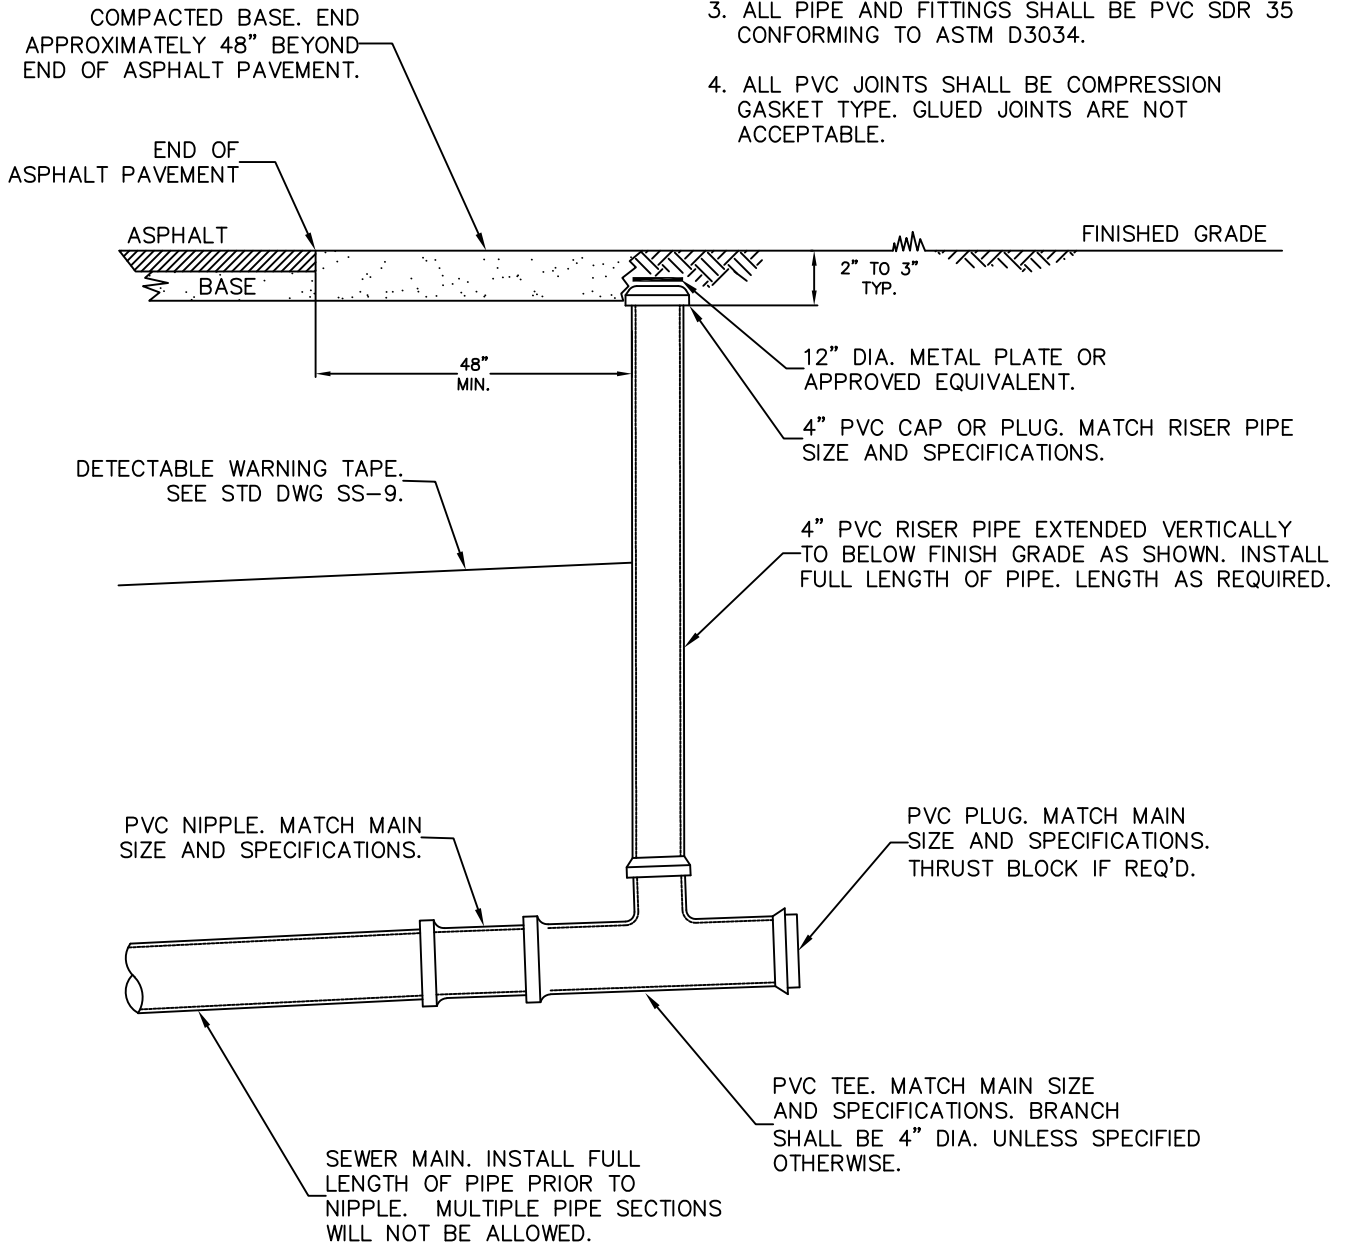

REVISION	APPROVED	DATE	CITY OF COEUR d'ALENE STANDARD DRAWING	APPROVED BY:
				<h2>TEMPORARY TEE</h2> <h2>SEWER EXTENSION</h2>
			DWG NO. SS-11	

7/2/18
DATE: