


ITEM NO.	NO. REQ'D.	DESCRIPTION
1	1	1" ROMAC DOUBLE STRAP SERVICE SADDLE
2	1	IPS x 1" POLY PACK JOINT BRONZE CORPORATION STOP
3	1	1" x REQ. LENGTH - USE PIPE SIZE, 250 PSI POLYETHYLENE SERVICE LINE
4	2	1" IPS x 1" POLY BRASS PACK JOINT ADAPTER
5	1	1" x MIN 5' LONG - POLY PIPE STUB DISCHARGE SIDE
6	1	1" MALE POLY PACK WITH CAP
7	1	1" APPROVED NSF 61 COMPLIANT COPPERSETTER, ALL COMPONENTS
8	3	1" POLY INSERTS WHERE NEEDED
9	1	3/4" OR 1" BADGER CELLULAR READ METER (METER LAY LENGTH=7 1/2")
10	2	A24 ADAPTERS
11	3	ARMORCAST 13X24 RPM OR HUBBEL/QUASITE 1130 BOX W/ RADIO READ LID AND HINGED CAST IRON READER LID. BOX WILL CONSIST OF 18" BOTTOM AND MIDDLE SECTIONS, 12" TOP SECTION

- NOTES:**
- ALL MATERIALS USED IN CONTACT WITH POTABLE WATER ARE TO BE NSF-61 COMPLIANT.
 - STABILIZER BAR MUST BE USED FOR SETTINGS HAVING POLY PIPE ON BOTH FRONT AND BACK SIDES.
 - NO PRIVATE CONNECTIONS OR FITTINGS ALLOWED INSIDE THE METER BOX.
 - POLY PIPE MAY BE USED WHEN CONNECTING TO AN EXISTING SERVICE WHEN A GALVANIZED CONNECTION CANNOT BE EASILY MADE.
 - SEE STANDARD DRAWING W-2 FOR METER LOCATION.

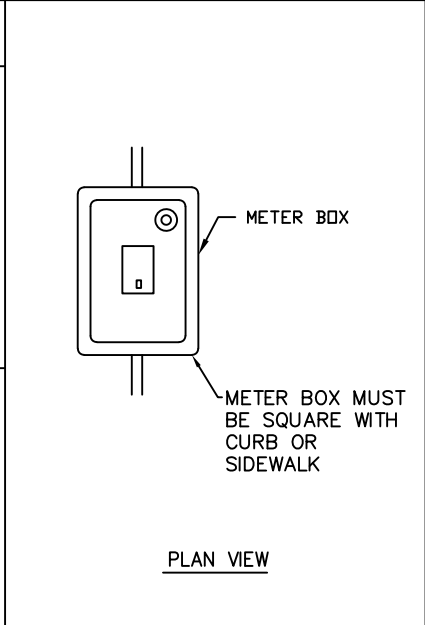

CITY OF COEUR D'ALENE STANDARD DRAWING

1" COPPERSETTER STANDARD PIT SETTINGS

APPROVED BY:

Chris Bosley 10/1/24
CITY ENGINEER, PE 10600 DATE:

DWG NO. W-1