



CITY APPROVED RPBA PER STANDARD DRAWING W-32

CITY STANDARD METER SETTING, PER STANDARD DRAWINGS W-1, W-14

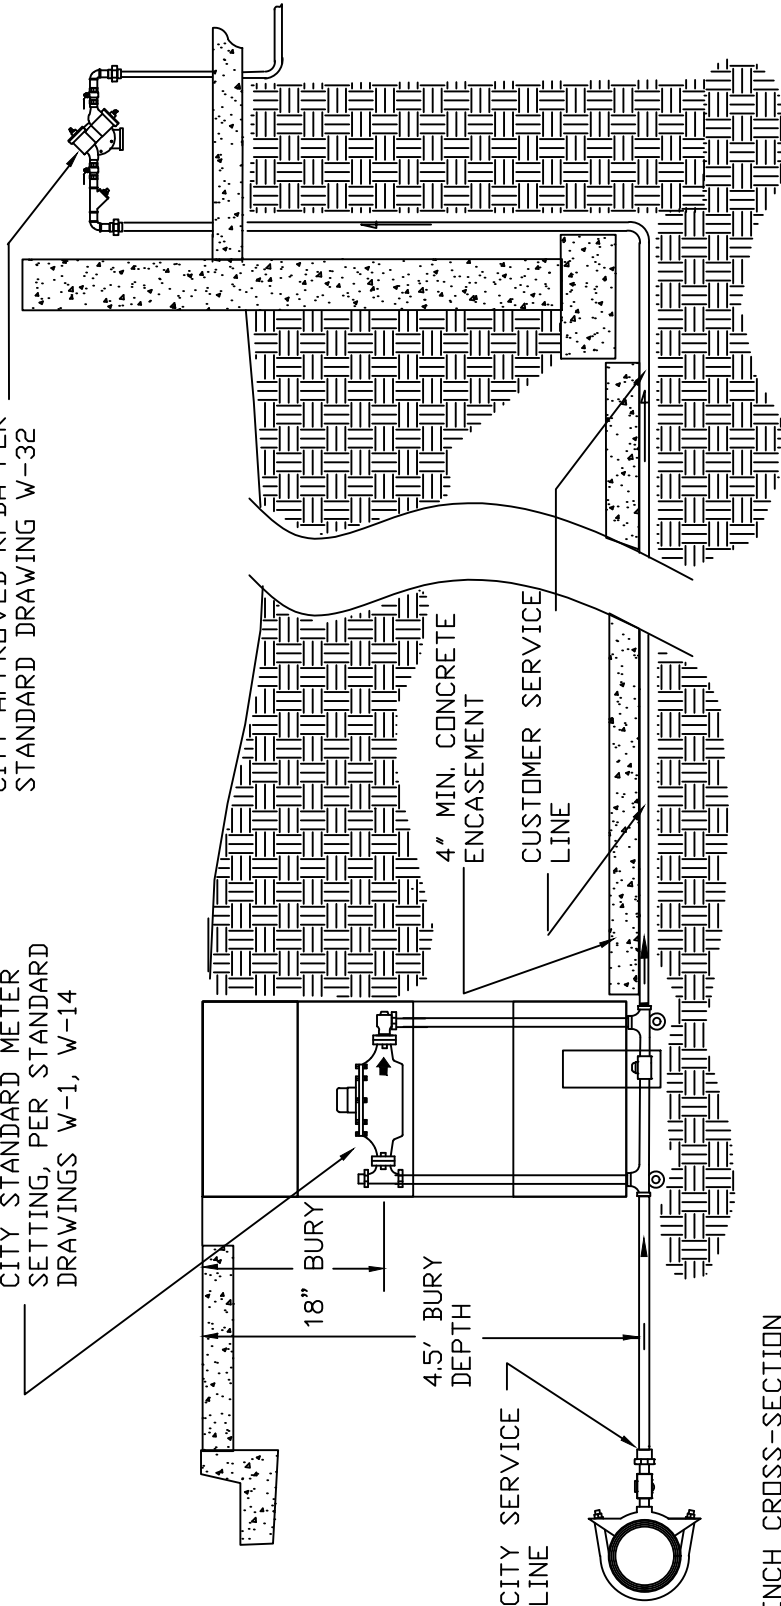

TRENCH CROSS-SECTION

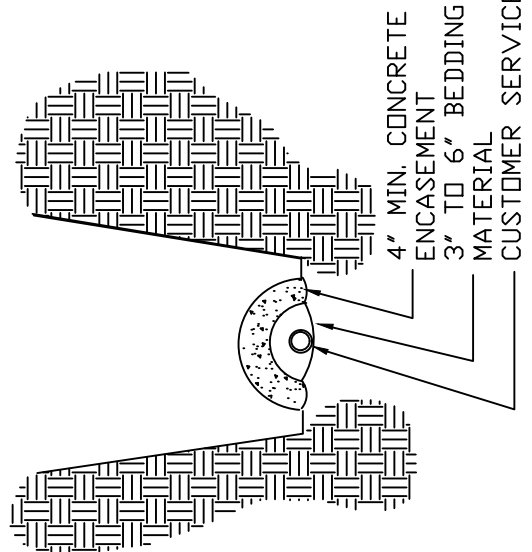

1. THE PROPERTY OWNER, AS A CONDITION OF ALLOWING THE RPBA TO BE INSTALLED INSIDE THE STRUCTURE, SHALL COVER THE CUSTOMER SERVICE LINE FROM THE BASE OF THE METER BOX TO THE BASE OF THE INLET RISER AT THE RPBA WITH A MINIMUM OF 4" OF CONCRETE OVER 3 TO 6" OF FINE BEDDING MATERIAL AS ILLUSTRATED.
2. THE PROPERTY OWNER SHALL SIGN A RECORDABLE EASEMENT PROHIBITING CONNECTIONS INTO THE SERVICE LINE BETWEEN THE METER AND THE RPBA.
3. THIS METHOD SHALL BE UTILIZED WHERE AUXILIARY SOURCES OF WATER EXIST ON THE PROPERTY TO BE SERVED PER SPECIAL APPROVAL OF THE IDAHO DEPARTMENT OF ENVIRONMENTAL QUALITY.

REVISION	APPROVED	DATE

CITY OF COEUR d'ALENE STANDARD DRAWING

**RPBA PREMISE ISOLATION  
ALTERNATE METHOD**

APPROVED BY:

*Chris Bosley*  
CITY ENGINEER, PE 10802

4/13/18  
DATE:

DWG NO.

W-21