


**AIR GAP** - MINIMUM OF TWICE  
THE INLET PIPE DIAMETER  
ABOVE THE FLOOD RIM BUT  
NEVER LESS THAN 1 INCH.

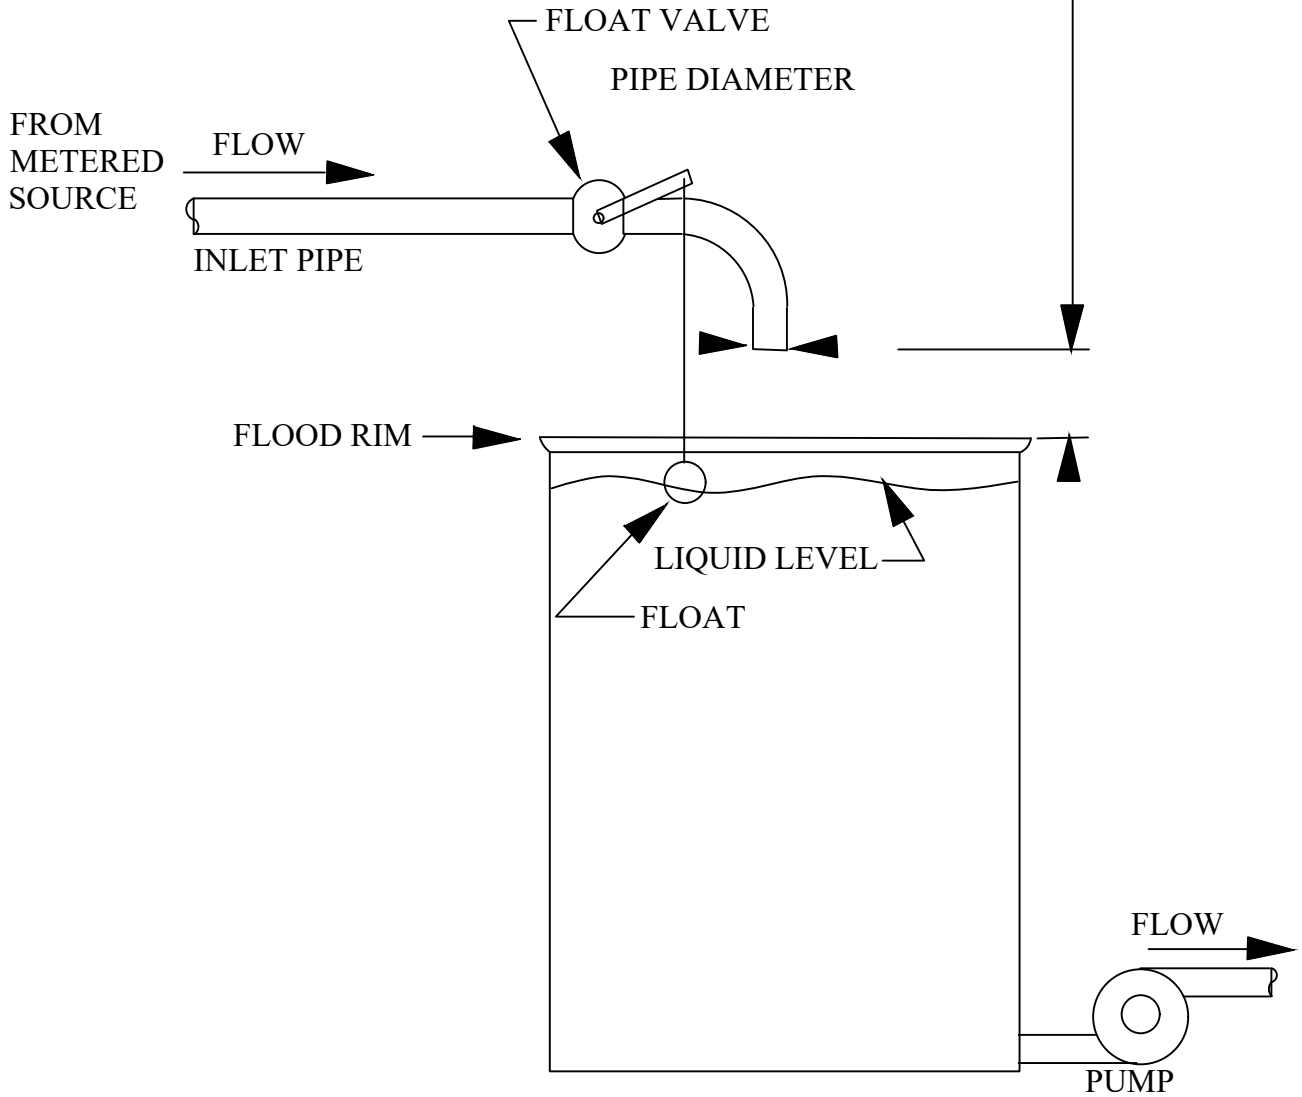

CITY OF COEUR D'ALENE STANDARD DRAWING

APPROVED BY:

**APPROVED AIR GAP**

*Chris Bosley*  
CITY ENGINEER, PE 10804

10/1/24  
DATE:

DWG NO.

W-27