


THE PROPERTY OWNER, AS A CONDITION OF GRANTING SERVICE WHERE PREMISE ISOLATION IS REQUIRED, SHALL INSTALL AN APPROVED RPBA A MAXIMUM OF 2' BEHIND THE METER OR AT THE PROPERTY LINE AS DIRECTED BY THE CITY. THE RPBA SHALL BE INSTALLED ABOVE GRADE OR FLOOD PLAIN AS PER STANDARD INSTALLATION REQUIREMENTS AND SHALL BE ENCLOSED IN AN APPROVED INSULATED AND HEATED ENCLOSURE WITH ADEQUATE DRAINS.

TRENCH CROSS-SECTION

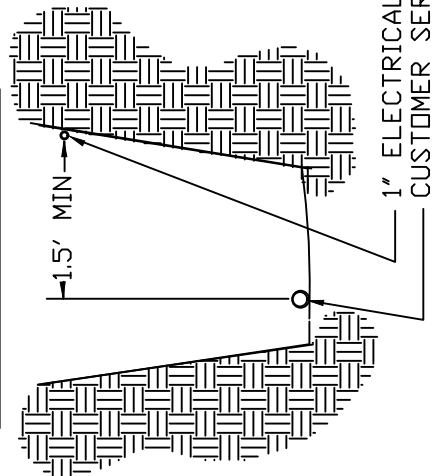

CITY OF COEUR D'ALENE STANDARD DRAWING

**RPBA PREMISE ISOLATION  
STANDARD METHOD**

APPROVED BY:

*Chris Busby*  
CITY ENGINEER, PE 10604

10/1/24  
DATE:

DWG NO.

W-20